


NOTE: UNLESS OTHERWISE SPECIFIED

1. WHEN EXCLUSION IS PROVIDED ON A 4-WIRE LINE-DISCONNECT, INSULATE AND STORE THE R-Y, G-Y AND BK-W EXCLUSION KEY LEADS. CONNECT ET AND ER LEADS FROM SET TO EXTERNAL PICKUP RELAY ASSOCIATED WITH CONTROL STATION. WHEN EXCLUSION IS PROVIDED ON A 2-WIRE LINE, CONNECT THE R-Y, G-Y AND BK-W EXCLUSION KEY LEADS TO R,T,F,H TERMINALS OF LINE INVOLVED (SET IS FURNISHED WITH EXCLUSION KEY LEADS WIRED TO EXCLUDE LINE 1.)
2. * INDICATES LEADS INDIVIDUALLY INSULATED AND STORED.
3. NO WIRING CHANGES ARE NECESSARY ON KEYS 4 & 5 WHEN CONVERTING TO TRANSFER OPTION.
4. AN AC BUZZER WILL BE USED FOR INTERNAL SIGNALING IF REQUIRED.

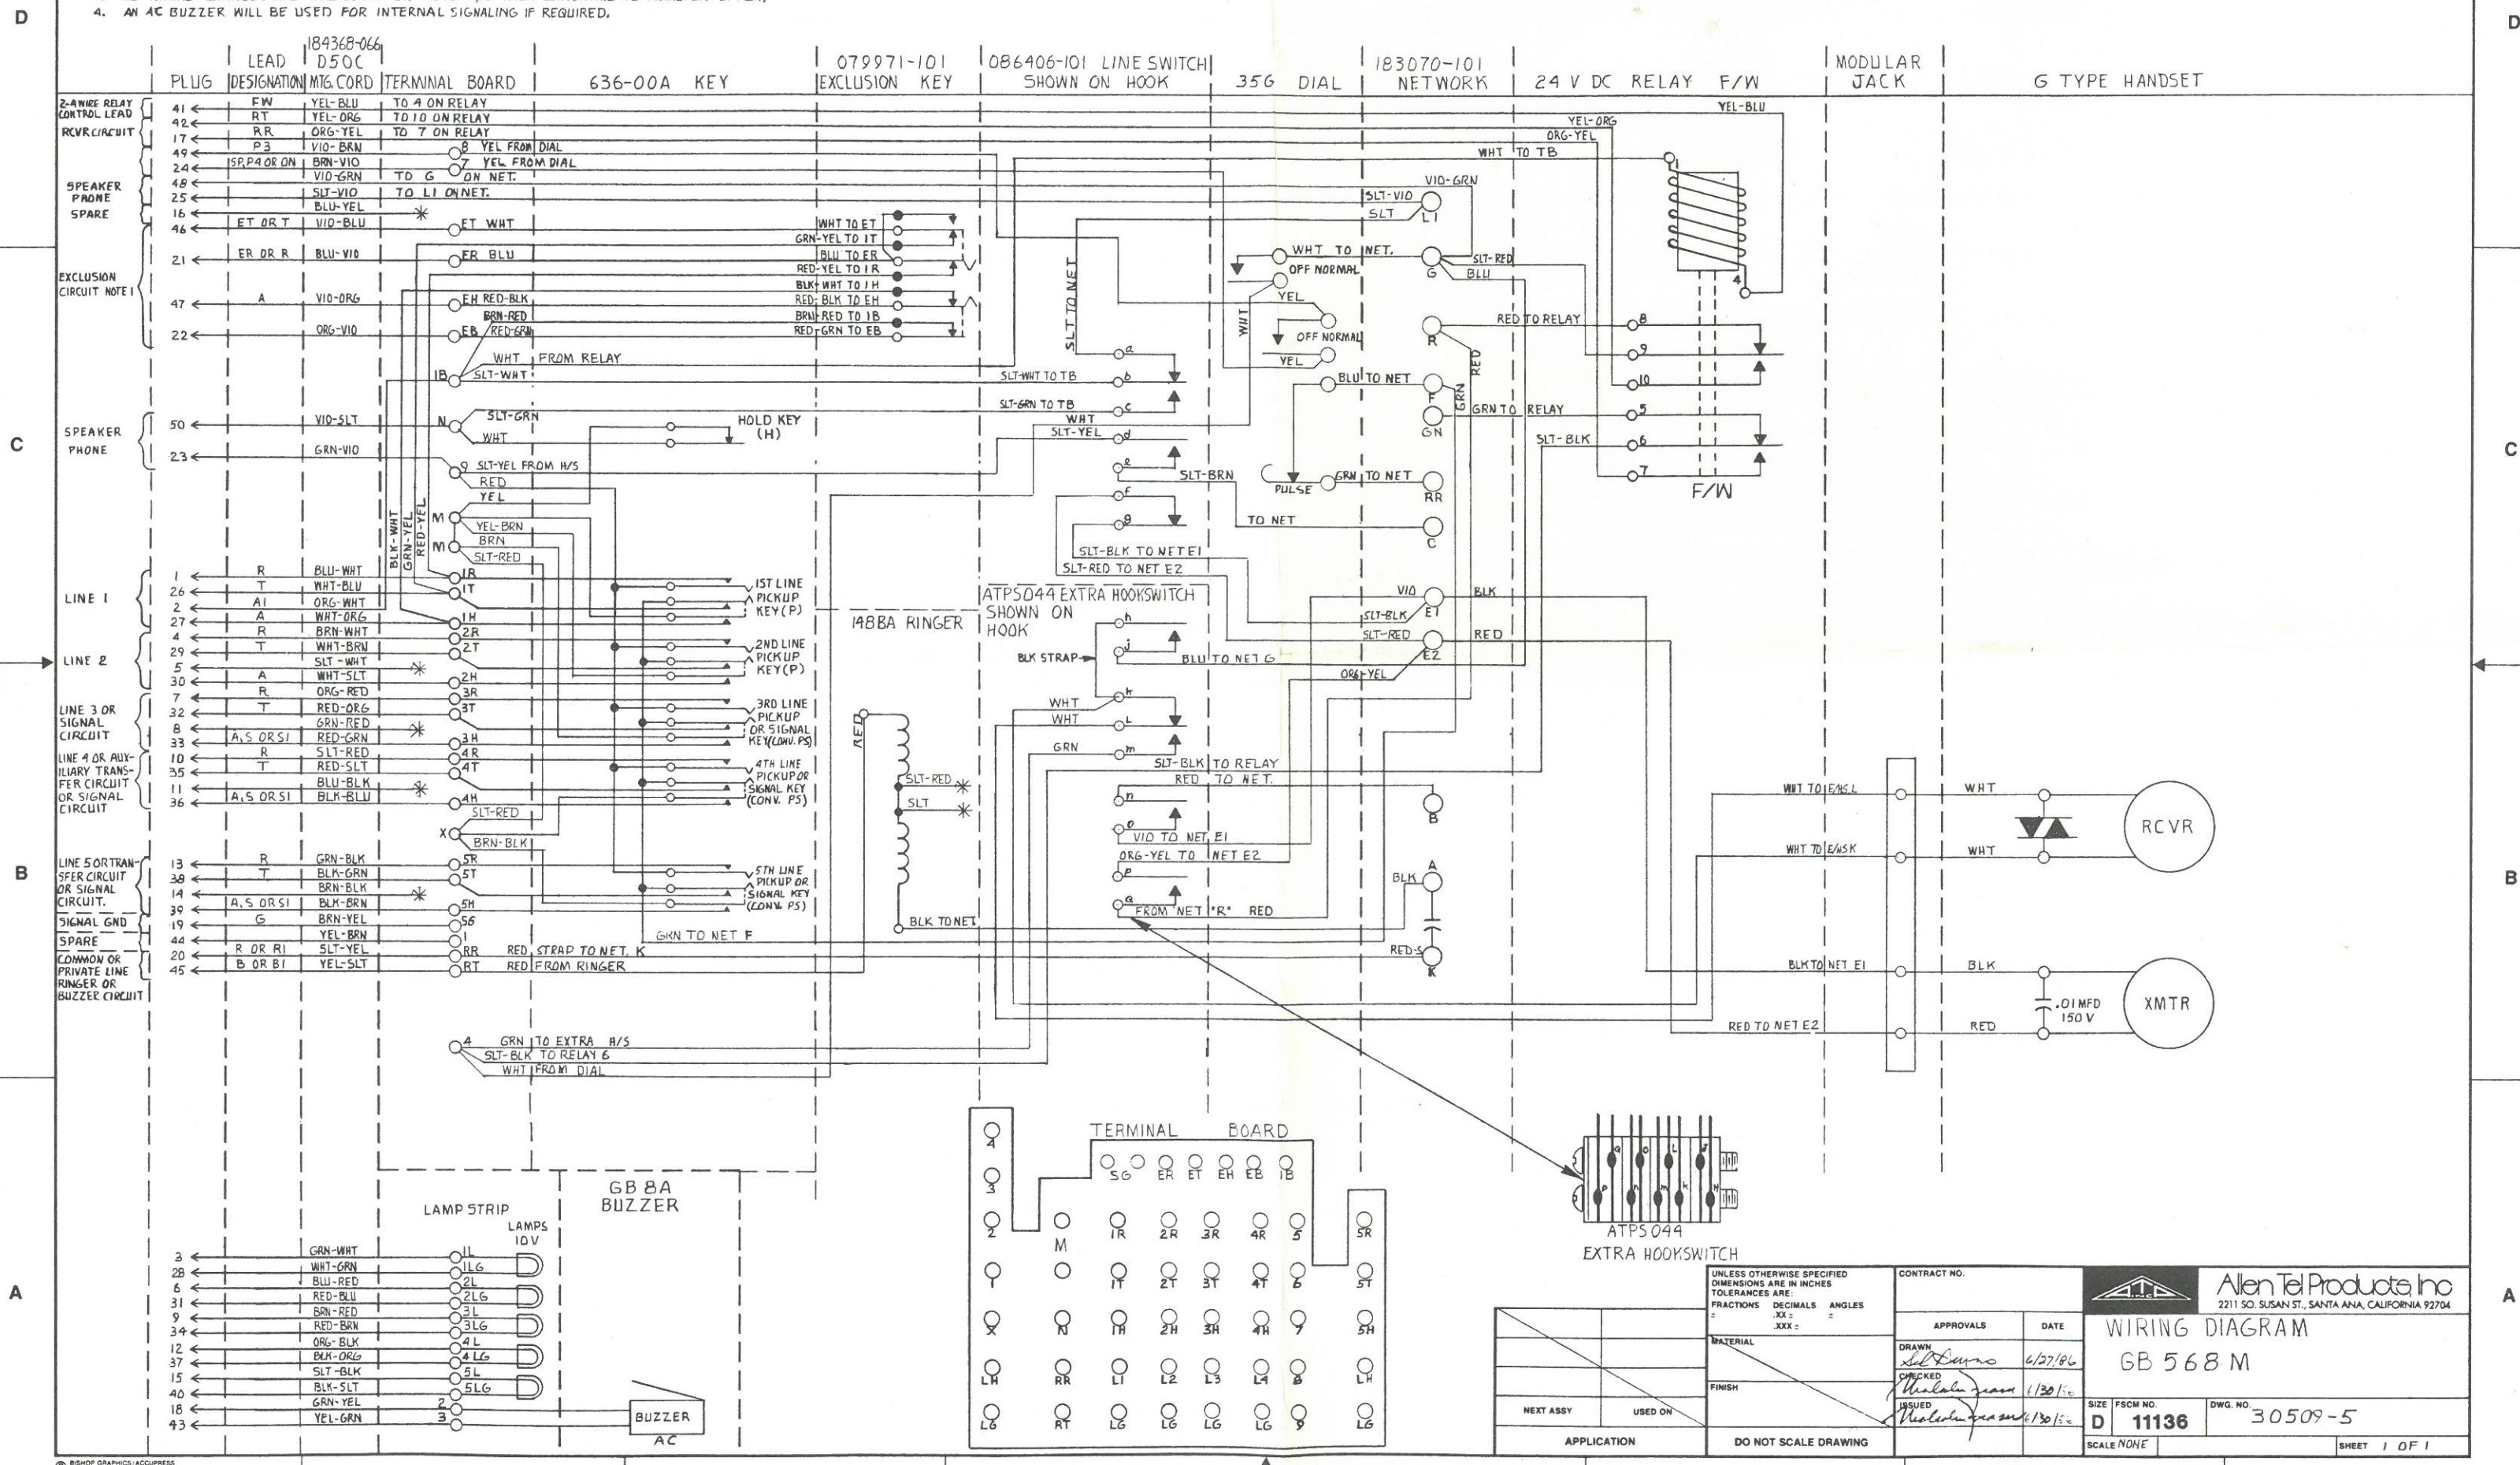

TERMINAL BOARD	
1G	5G
2G	6G
3G	1L
4G	2L
5G	3L
6G	4L
1H	5L
2H	6L
3H	1G
4H	2G
5H	3G
6H	4G
1R	5R
2R	6R
3R	1L
4R	2L
5R	3L
6R	4L
1T	5T
2T	6T
3T	1H
4T	2H
5T	3H
6T	4H
1B	5B
2B	6B
3B	1R
4B	2R
5B	3R
6B	4R
1E	5E
2E	6E
3E	1T
4E	2T
5E	3T
6E	4T
1I	5I
2I	6I
3I	1B
4I	2B
5I	3B
6I	4B

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE: FRACTIONS DECIMALS ANGLES .XX ± .XXX ±		CONTRACT NO.	
MATERIAL		APPROVALS	DATE
FINISH		DRAWN <i>[Signature]</i>	6/27/86
NEXT ASSY USED ON		CHECKED <i>[Signature]</i>	1/30/86
APPLICATION		ISSUED <i>[Signature]</i>	6/13/86
DO NOT SCALE DRAWING		 2211 SO. SUSAN ST., SANTA ANA, CALIFORNIA 92704	
SCALE NONE		WIRING DIAGRAM GB 568 M	
D 11136		SIZE FSCM NO. DWG. NO. 30509-5	
SHEET 1 OF 1			